

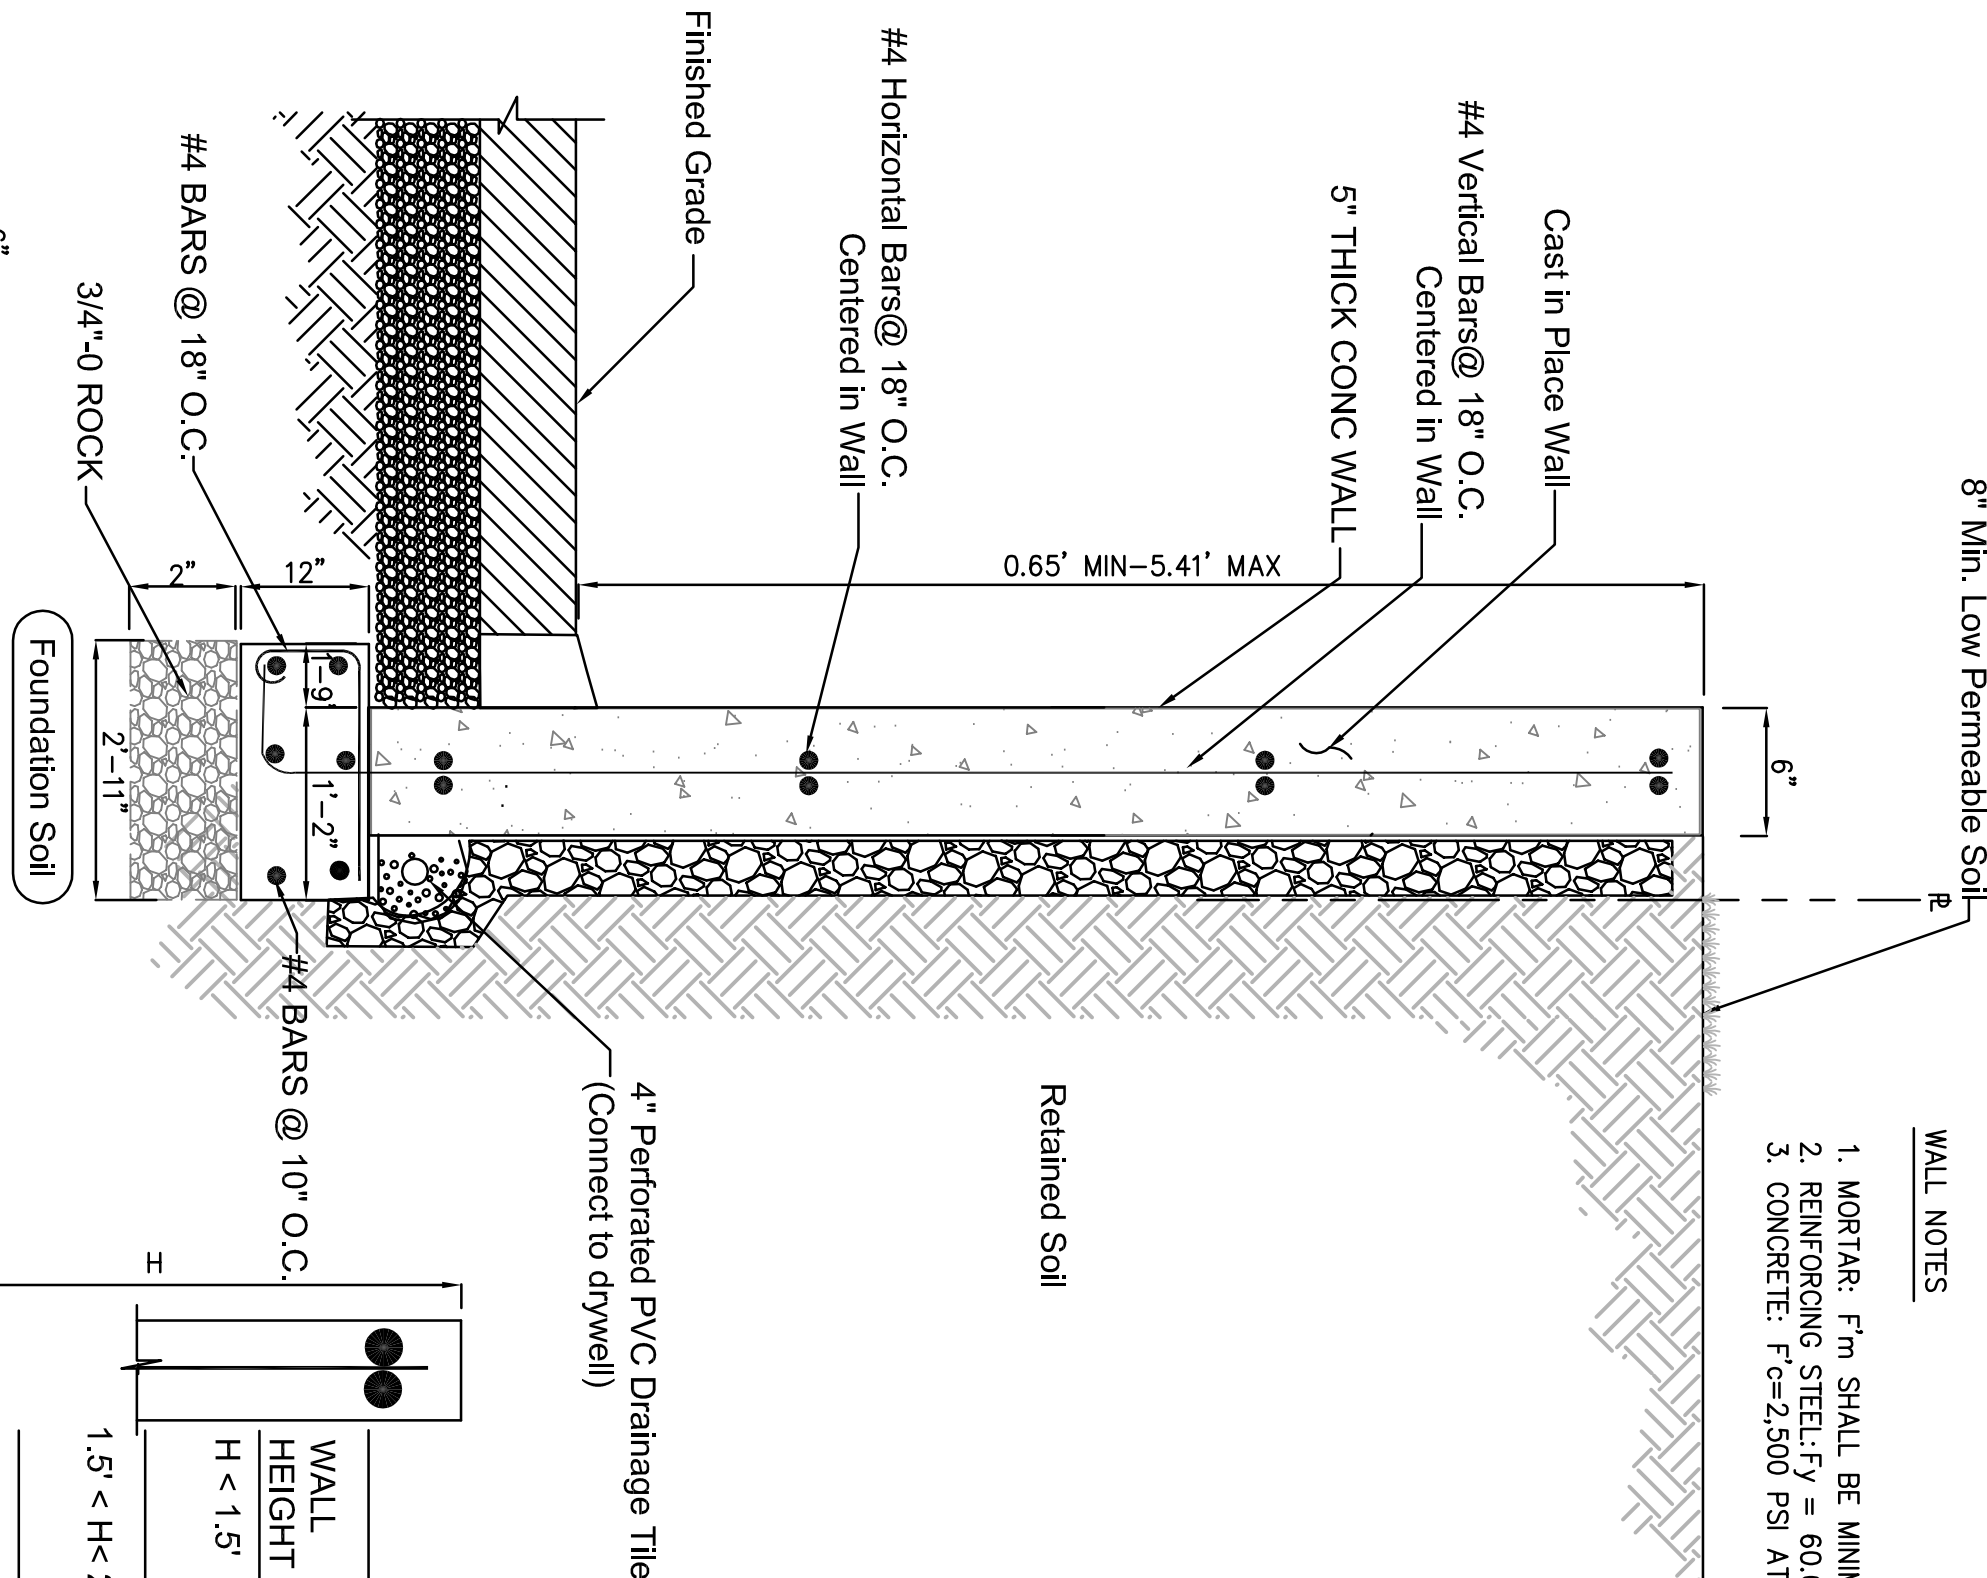
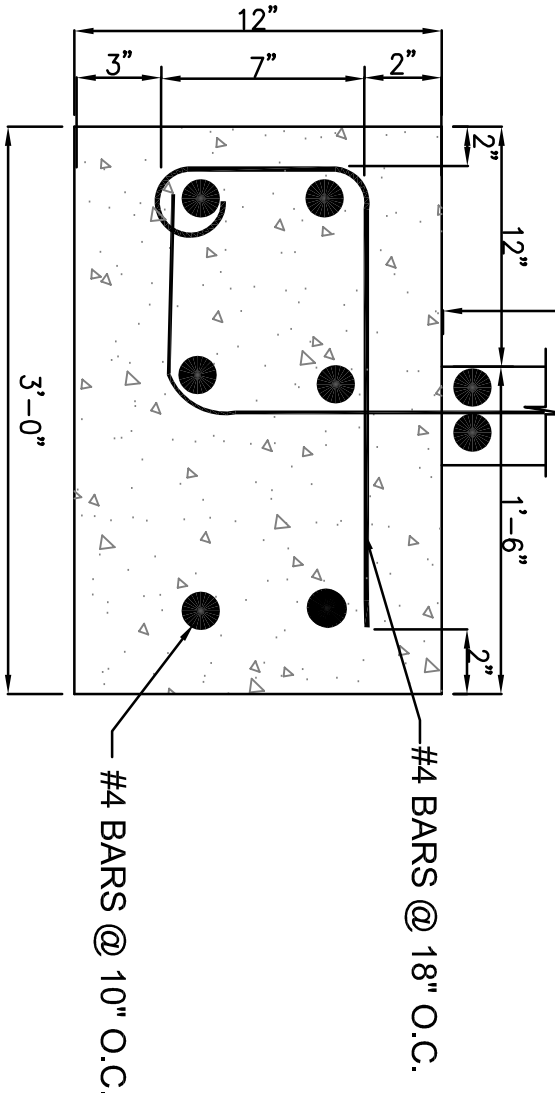


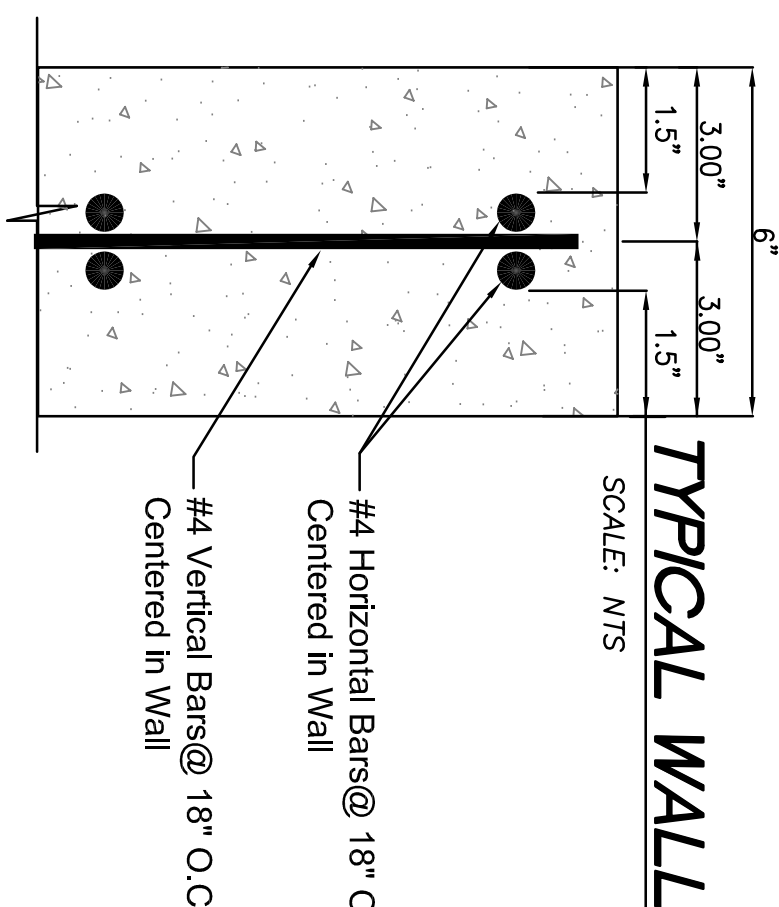

1. MORTAR: F'm SHALL BE MINIMUM 1800 PSI, TYPE "S" PER ASTM C270.
2. REINFORCING STEEL: F'y = 60,000 PSI PER ASTM A615
3. CONCRETE: F'c=2,500 PSI AT 28 DAYS PER ASTM C94

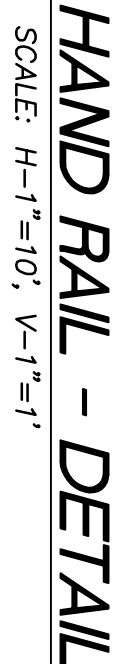

AFC URGENT CARE CLINIC
NW CORNER OF
MOLALLA AVE & WARNER-MILNE RD
OREGON CITY, OREGON


PROJECT
NUMBER: 1740

DRAWING	DATE	BY
DESIGN	18 APR 2018	SG5
LAND USE REVIEW	25 APR 2018	SG5
PERMIT SET	31 JULY 2018	SG5
 REVISION SET	19 SEPT 2018	SG5
 8 NOV 2018	SG5	
CONTRACT SET	6 DEC 2018	SG5
 10 JUN 2019	SG5	

SHEET TITLE
SITE PLAN &
DETAILS

SHEET #

B0.3

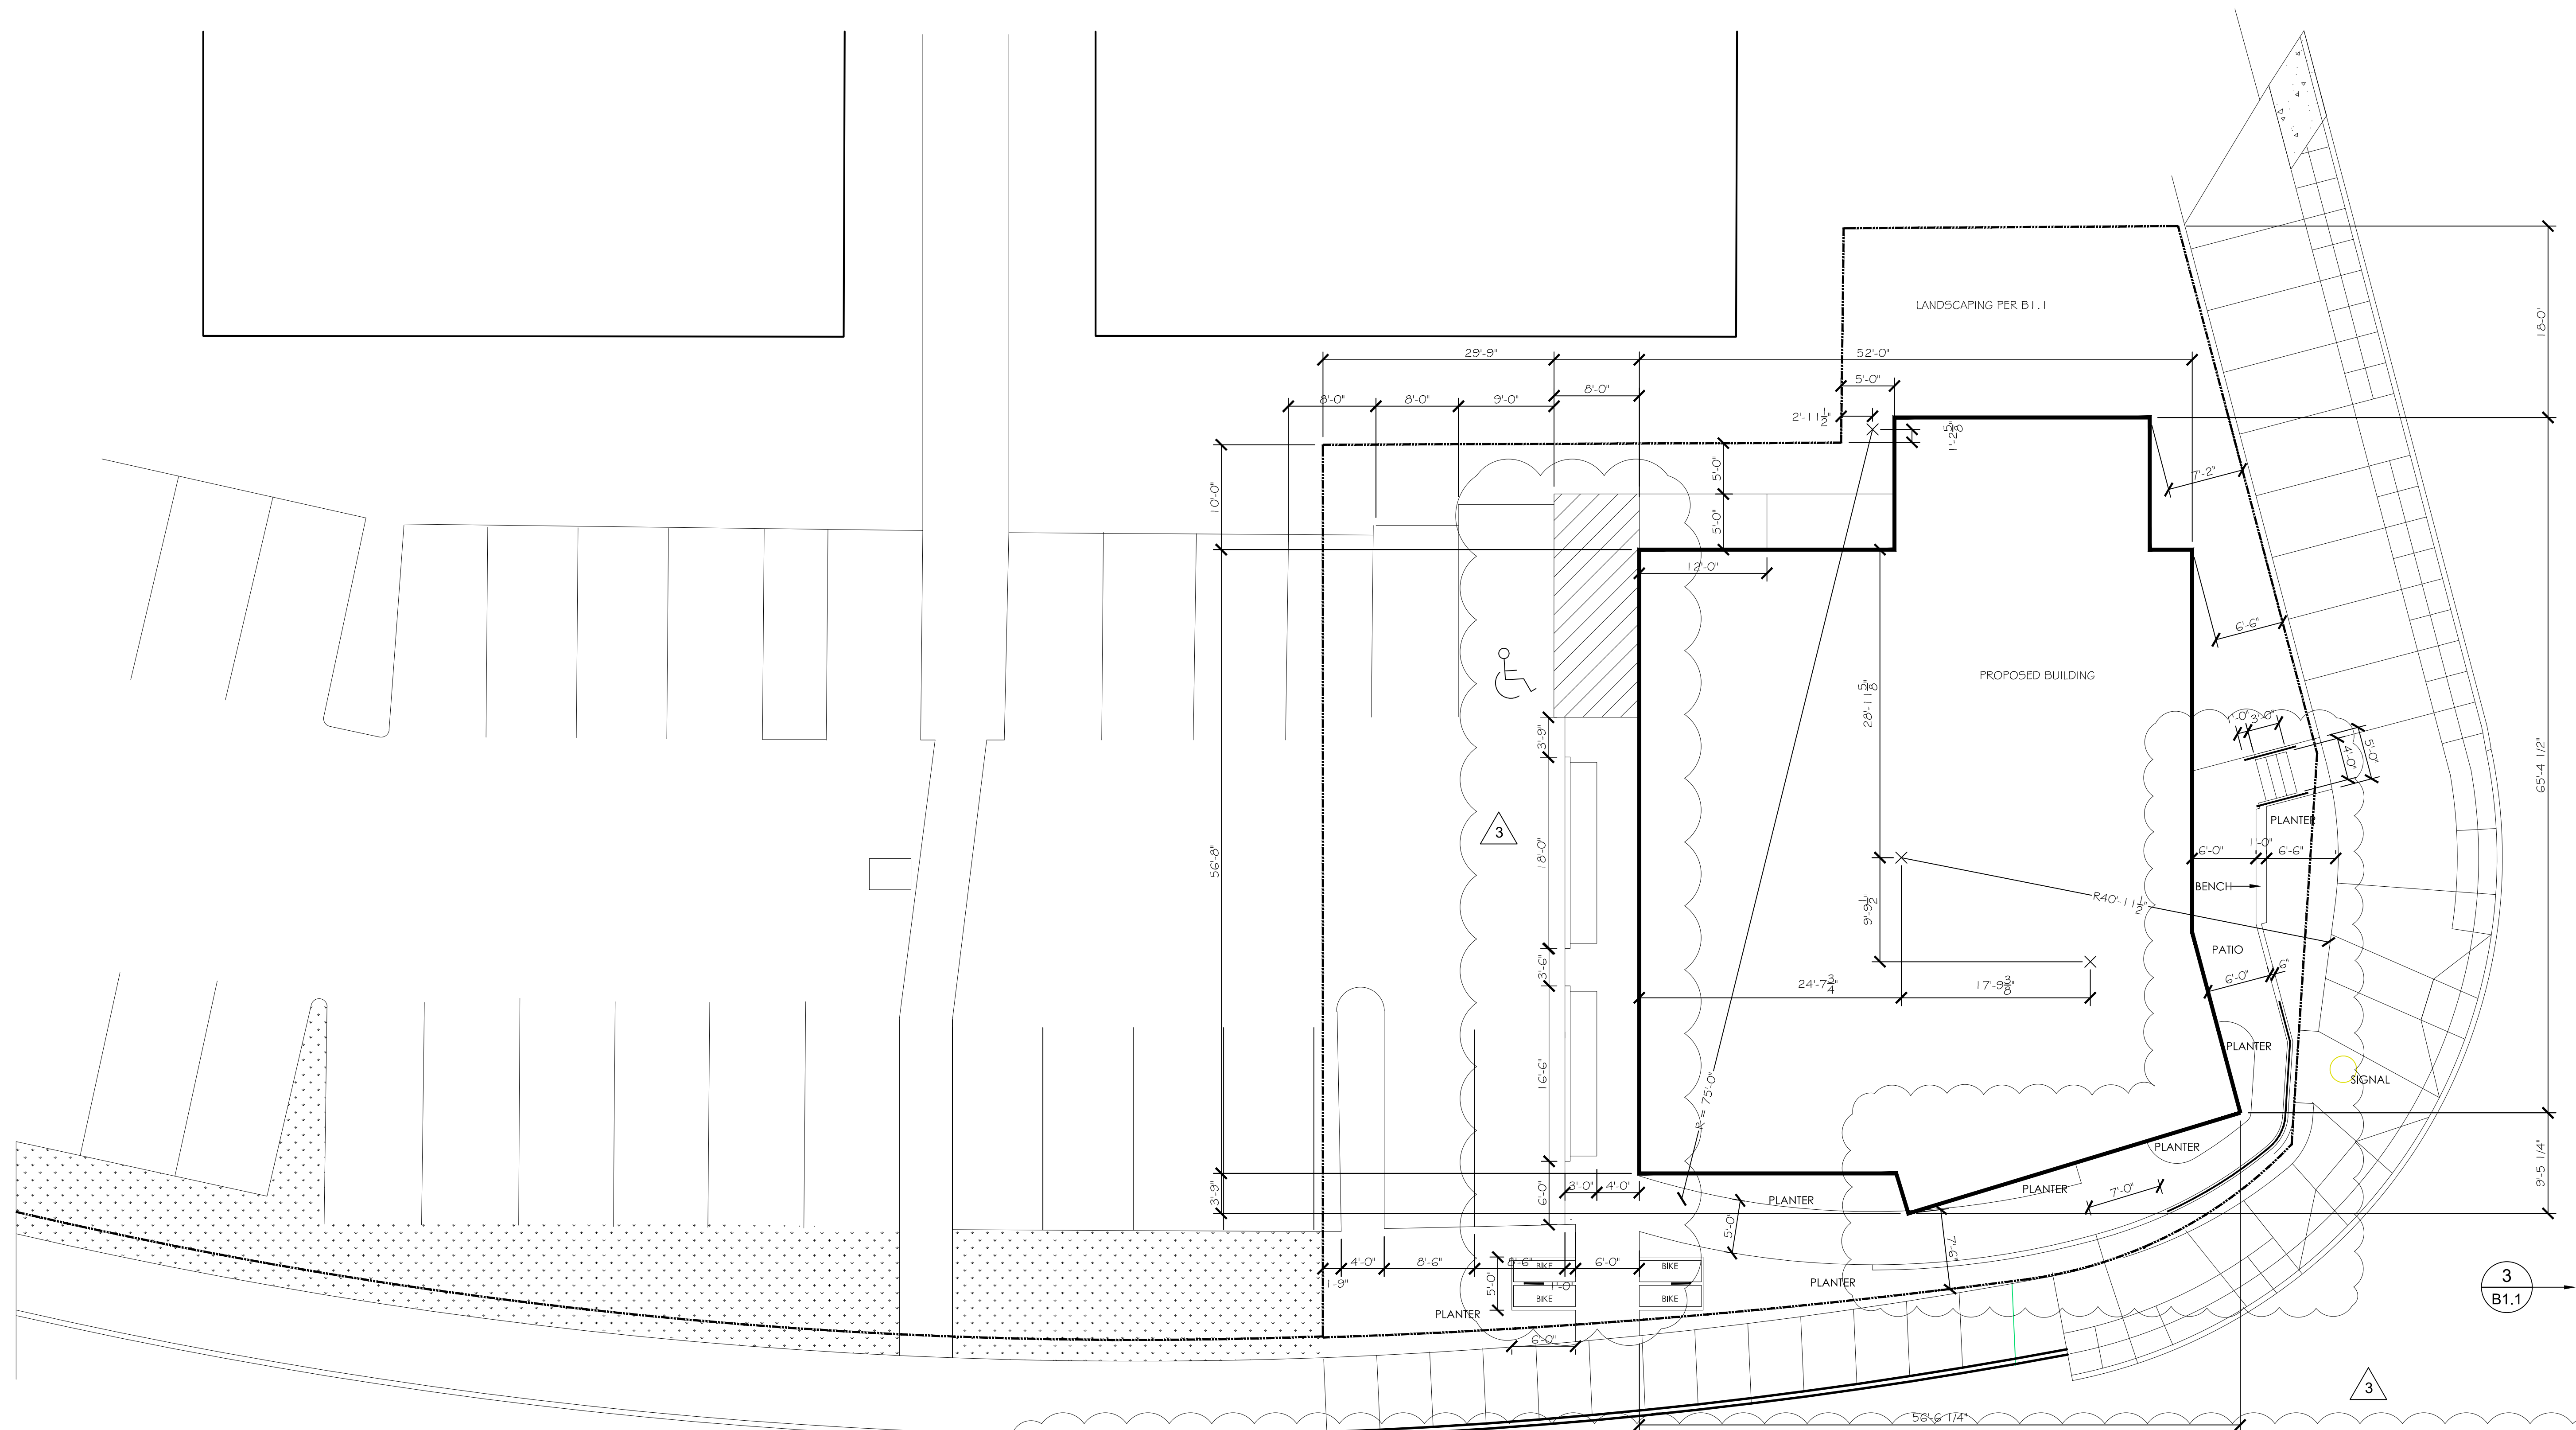


1 SITE PLAN
B0.3 1/8" = 1'-0"


SEE CIVIL DRAWINGS FOR ADDITIONAL SITE INFORMATION



2	BIKE RACK
B0.3	3/4" = 1'-0"

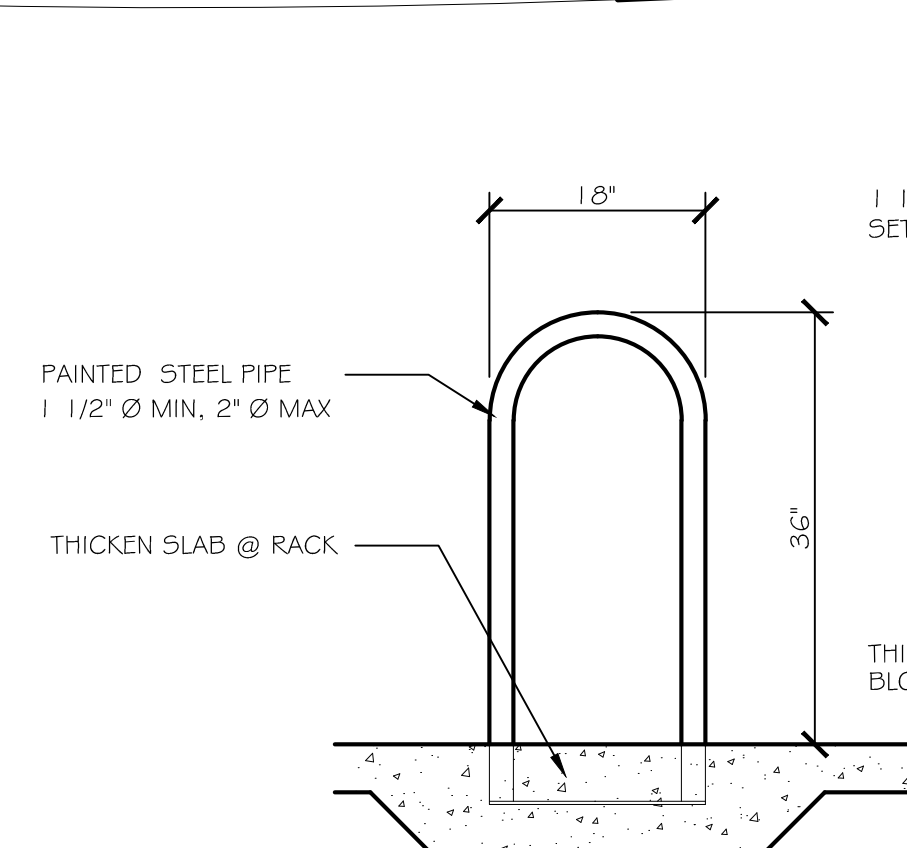

3 HANDRAIL / STEPS
B0.3 $3/4" = 1'-0"$

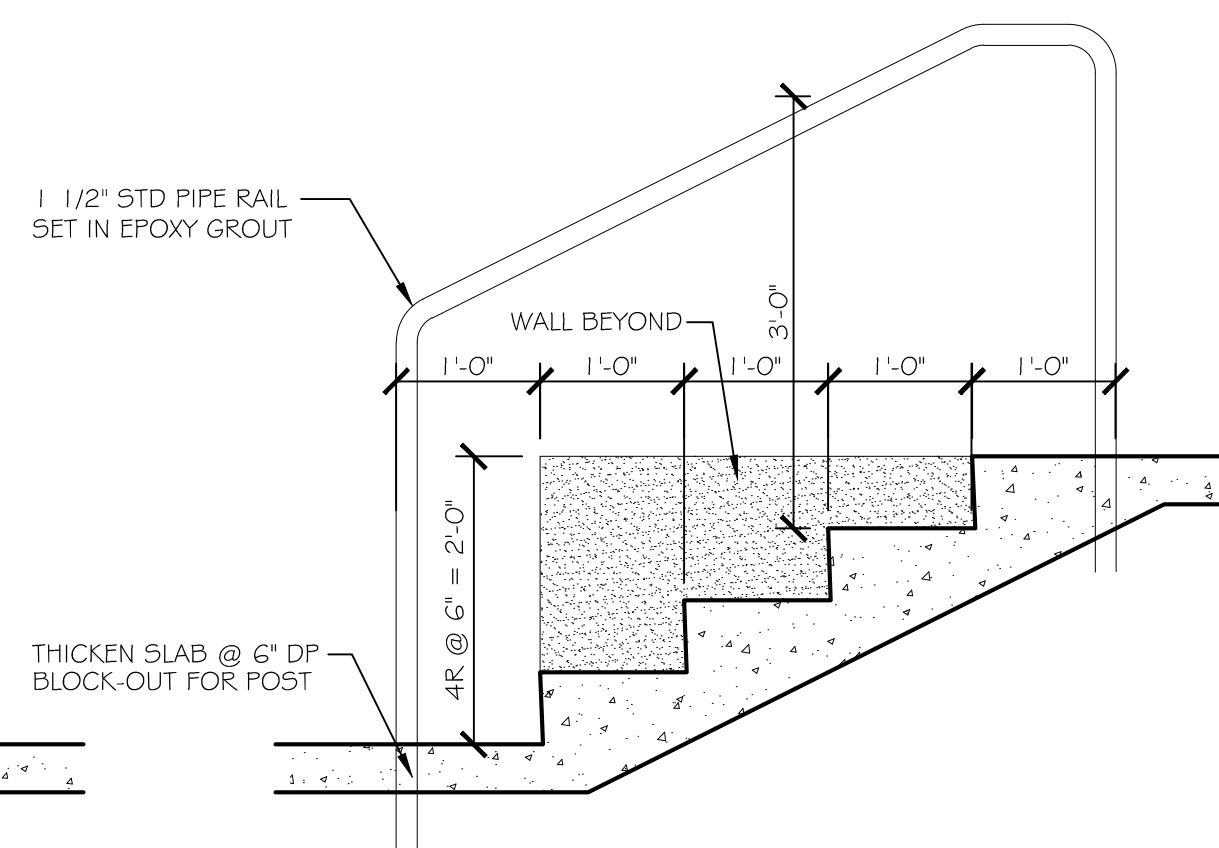

4 GUARDRAIL @ WALL
B0.3 $3/4" = 1'-0"$

